

Idaho State University Networking & Telecommunications Cabling and Contractor Specifications

1.0 GENERAL

This document is general in nature and not specific to a particular project. It is, however, the minimum standard by which all construction documents, particular to any project, should be based.

1.1 STANDARDS

A.

Building structured wiring systems shall meet the cabling conventions of Idaho State University (ISU) Networking & Telecommunications Department (NeTel) to include adherence to the most currently available Building Industry Consulting Service International (BICSI) Telecommunications Distribution Methods Manual (TDMM 10th Edition), ANSI/TIA/EIA Telecommunications Building Wiring Standards ISBN: 0-9112702-73-7, National Electrical Manufacturer's Association (NEMA) NEMA WC 26, and National Electrical Code 2005 NFPA 70 manuals as adopted by ISU. In projects involving new construction, ISU NeTel recommends architectural and engineering firms use CSI Master Format 2004, Division 27 - Communications, for construction documents.

Bidders shall be fully acquainted with the above referenced standards and be fully qualified, as outlined in the Telecommunications contractor qualifications, to bid on and perform work. Bidders shall have demonstrated manufacturer authorization, qualifications and certifications to install and test a Category 5E (CAT 5E) Ortronics/Berk-Tek NetClear GT Structured Cable Channel Solution and 1000BaseTX/FX intra-building backbone. All station and riser cabling shall be tested and certified by successful bidder to support 1000BaseTX/FX technology. Additionally, the successful bidder will be required to meet ISU conventions and standards. The successful bidder will be required to meet with and coordinate with a representative of ISU NeTel prior to work beginning, and weekly, during the installation process. Weekly meetings will include a site inspection to ensure compliance with the defined standards contained in this document. The successful electrical and telecommunications contractor(s) shall follow appropriate installation guidelines, as contained in the most currently available BICSI TDMM, ANSI/TIA/EIA, NEMA WC 26, and NFPA 70 manuals. Additionally, contractor will work with ISU NeTel to ensure proper placement and routing of cable and support hardware. The specified Structured Cable Wiring Standards are to be used as a minimum requirement.

1.2 TELECOMMUNICATIONS CONTRACTOR QUALIFICATIONS

A.

ISU requires only qualified and experienced Telecommunications contractors perform design, project management, and installation services in the construction of the ISU structured cabling infrastructure. Pursuant to this, ISU wants to ensure that successful contractors have the manufacturer authorizations, capabilities, qualifications, financial stability, and experience to complete Telecommunications installations using common industry practices (i.e. BICSI TDMM, ANSI/TIA/EIA, NEMA, NFPA, etc) while meeting all ISU guidelines.

B.

A contractor, by responding to a bid, represents that their company possesses the manufacturer authorizations, qualifications, certifications, capabilities, test equipment, expertise, and personnel necessary to provide an efficient and successful installation of properly operating components, as specified.

C.

Bidder must meet the requirement of having continuously performed Telecommunications installation work for a period of at least five (5) years. The Telecommunications contractor must be an approved Ortronics Certified Installer at a Plus tier (CIP, CIP-GOLD, CIP-PLATINUM, and multi-site/national contractor) and/or Berk-Tek Certified OASIS Integrator. A copy of certification documents must be submitted with the quote in order for such quote to be valid. The Telecommunications contractor is responsible for workmanship and installation practices in accordance with the Ortronics CI/CIP Program and Berk-Tek OASIS Program. Ortronics/Berk-Tek will extend a NetClear 25-year Static, Dynamic and Applications Warranty to the end user once the Telecommunications contractor fulfills all requirements under Ortronics CI/CIP and/or Berk-Tek OASIS Program. At least 30 percent of the copper installation and termination crew must be certified by BICSI and Berk-Tek, or BICSI and Ortronics, with a Technicians Level of Training.

D.

Prior to submitting bid, bidder is required to carefully consider the amount and character of the work to be done, as well as the difficulties involved in its proper execution. Bidder should include in their bid all costs deemed necessary to cover contingencies essential to successfully installing the specified system. Any cost not specifically itemized in the proposal shall not be incurred unless specifically agreed upon by all parties and documented in writing. No claims for compensation will be considered or allowed for extra work resulting from lack of knowledge of any existing conditions on the part of the bidder.

E.

ISU requires references from projects of a similar size and nature. Names of the officers of the company and resumes of those to be assigned to the project, including subcontractors, must be provided. Telecommunications contractor shall, at all times during performance of work, and until work is completed and accepted, have on the premises a competent supervisor satisfactory to ISU and with authority to act for the Telecommunications contractor regarding work schedules and any changes to the scope of work. The supervisor must be a BICSI certified Technician and a BICSI member in good standing.

F.

As a requirement to bidding and performing awarded work, Telecommunications contractor shall have a currently registered and certified BICSI Registered Communication Distribution Designer (RCDD) on staff as a full-time employee. A copy of the RCDD certificate and BICSI member number must be provided with bidding documents.

G.

Telecommunications contractor must provide at least one project manager or lead technician on site at all times during project whom is a BICSI certified Technician and a BICSI member in good standing. A copy of certificate and BICSI member number must be provided with bidding documents. Weekly inspections and approval of all work performed shall be conducted by an RCDD.

H.

Telecommunication contractor must be skilled and proficient in both inside cable plant (copper and fiber optics) installation, as well as outside cable plant (copper and fiber optics) installation, termination, splicing, and testing. Telecommunications contractor must be certified by the manufacture of the structured cable system specified in this document. (See 1.5 Materials)

1.3 PROGRESS MEETINGS

A.

The successful bidder will be required to meet with and coordinate with a representative of ISU NeTel prior to work beginning, and weekly, during the installation process. Weekly meetings will include a site inspection to ensure compliance with established standards. The successful electrical and Telecommunications contractor(s) will follow appropriate installation guidelines, as contained in the most currently available BICSI TDMM, ANSI/TIA/EIA Wiring Standards, NEMA and NFPA 70 National Electrical Code manuals. Additionally, contractor will work with ISU NeTel to ensure proper placement, routing, labeling, and documentation of cable and support hardware.

1.4 DOCUMENTATION

A.

Prior to system acceptance, the successful bidder shall submit to the owner fully documented 8.5" x 11" scale drawings of the entire fiber optic and copper distribution system. Documentation shall be provided in both a hard copy binder and a soft copy on CD capable of being viewed and edited in MS Visio. This will include building and floor layouts with appropriate labeling and locations of workstation Telecommunications Outlet (TO), Equipment Room/Telecommunications Room (ER/TR), Main Cross Connect/Intermediate Cross Connect (MC/IC), cable routes, interconnect locations, riser locations, and all other information pertinent to the installation.

B.

Successful bidder will be responsible for accurately labeling and identifying all relevant components of the cabling system, including, but not limited to: TO face plate labeling; patch panel and block labeling and color-coding; backbone cable labeling at entrance to MC, BEF/IC/ER, and HC/TR; fiber optic patch panel labeling and color-coding, cables at each end, conduits at each end, and grounding system. Reference BICSI TDMM, 10th Edition, Chapter 14 Telecommunications Administration. The successful bidder will consult with ISU NeTel's representative in regard to labeling and identification.

1.5 MATERIALS

Idaho State University, through an exhaustive bid process in May 2000, selected the Ortronics/Berk-Tek NetClear Structured Cabling Solution for a campus wide cable upgrade/replacement project. ISU desires to protect its investment in training, certifications, and inventory, therefore, all new construction and remodel projects shall include Ortronics/Berk-Tek NetClear Cabling Solution products as specified.

The Telecommunications contractor must be an approved Ortronics Certified Installer at a Plus tier (CIP, CIP-GOLD, CIP-PLATINUM, and multi-site/national contractor) and/or Berk-Tek Certified OASIS Integrator. A copy of certification documents must be submitted with the quote in order for such quote to be valid. The Telecommunications contractor is responsible for workmanship and installation practices in accordance with the Ortronics CI/CIP Program and Berk-Tek OASIS Program. Ortronics/Berk-Tek will extend a NetClear 25-year Static, Dynamic and Applications Warranty to the end user once the Telecommunications contractor fulfills all requirements under Ortronics CI/CIP and/or Berk-Tek OASIS Program. At least 30 percent of the copper installation and termination crew must be certified by BICSI and Berk-Tek, or BICSI and Ortronics, with a Technicians Level of Training.

Bidder should expect to present quotes based on the following manufacturer's products. The horizontal workstation structured cabling system shall be an **Ortronics/Berk-Tek NetClear GT Channel Solution**. Bidder shall be authorized and certified, by the manufacturer's representative, to install, certify, and warranty, the structured cabling system. The specified Ortronics/Berk-Tek NetClear GT channel solution is not substitutable.

A. Horizontal Work Station Cable-

- Berk-Tek, LANmark-350, CMP, Category 5E, 4 twisted pair, 24 AWG, FEP, Station Wire for Plenum air return systems.

| Flame Rating | Jacket | Color | Part No. |
|--------------|-----------|------------|-------------------------------|
| CMP Plenum | PVC Alloy | Blue | Berk-Tek LANMark-350 10032065 |
| | | Yellow | Berk-Tek LANMark-350 10032060 |
| | | Light Gray | Berk-Tek LANMark-350 10032079 |

NOTE: Irrespective of air handling space, ISU requires the use of CMP Plenum rated cable for smoke and fire mitigation.

B. Intra-Building Backbone Cable-

- Berk-Tek Power Sum 10059632 CMP, Category 5e, 25 twisted pair, 24 AWG, FEP, Riser Cable for Plenum riser systems.
- Corning fiber optic riser cable, (6) strand, multi-mode, FDDI performance, 62.5/125um, 3.5/1.0 dB, MIC, TBII tight buffer tube construction, FEP.

C. Workstation Telecommunications Outlet (TO)-

| Description | Part No. |
|--|-------------------------------------|
| Ortronics TracJack USOC 6P6W RJ25C | OR-63700005-13 Ivory Jack |
| Ortronics TracJack T568A/B 180 deg | OR-TJ5E00-44 Dark Yellow Jack |
| Ortronics TracJack T568A/B 180 deg | OR-TJ5E00-36 Dark Blue Jack |
| Ortronics TracJack Face Plate | OR-40300547-13 3-Port Wall Plate |
| Ortronics TracJack Blank Modules (Pk of Ten) | OR-42100002-13 Ivory Blank |

D. IC/HC ER/TR Patch Panel Data Termination-

| Description | Ports | Part No. |
|--|-------|--------------|
| Ortronics High Density Patch Panel Modular to 110 T568A/B | 12 | OR-PSD5E6U12 |
| | 24 | OR-PHD5E6U24 |
| | 48 | OR-PHD5E6U48 |
| | 96 | OR-PHD5E6U96 |

E. Patch Cords-

| Description | Length | Part No. |
|--------------|--------|--------------|
| Blue, 4-pair | 3 ft. | OR-MC5E03-06 |
| | 5 ft. | OR-MC5E05-06 |
| | 7 ft. | OR-MC5E07-06 |
| | 9 ft. | OR-MC5E09-06 |
| | 15 ft. | OR-MC5E15-06 |
| | 20 ft. | OR-MC5E20-06 |
| | 25 ft. | OR-MC5E25-06 |

F. IC/HC ER/TR 110 Block Voice Termination-

| Description | Part No. |
|---|---------------|
| Ortronics 200-pair 19" Rack Mount 110 Field Termination Block/Panel Kit includes two 100-pair 110 blocks without legs, 56-110C3 and eight 110C4 connecting blocks, two jumper troughs, and designation. | OR-302003248 |
| 100-pair wall mount 110 Field Termination Block with 24 C6110C4 4-pair connecting blocks and snap-on label designation field. | OR-110ABC6100 |
| 110C5 Connecting Blocks, five-pair, Pk of ten. | OR-30200110 |

G. Outside Cable Plant and Termination-

Copper and fiber optics pair/strand count, composition and termination to be specified by ISU NeTel per specific project. See 2.2

H. BEF/IC/HC ER/TR Fiber Optic Cabinet and Termination- For Hubbell Next Frame Rack Installations:

- Corning FDC-CMH-072 Fiber Distribution Center 72-F 72 strand termination cabinet.
- Corning FDC-CP1 P-19 FDC single-mode ST connector 6 strand pre-loaded panel.
- Corning FDC-CP1 P-15 FDC multi-mode ST connector 6 strand pre-loaded panel.

For Hubbell RE4X Cabinet Installations:

- Hubbell AMO12 Base Unit Housing
- Hubbell AMOBST2 AMO Bracket with (2) ST Adapters

I. Grounding and Bonding-

- Chatsworth Products 40153-012 12" TMGB Pattern ANSI/EIA/TIA Grounding busbar.

J. Equipment Racks and Cabinets-

For Standard Equipment and Telecommunications Room Installations:

- Hubbell Next Frame 19" x 7' Equipment rack with 6" Vertical Organizer - 6" wide Z Channel and cover and Horizontal Cable Management. Black finish.

For Computer Labs, corridors and/or Zone Installations:

- Hubbell RE4X REBOX® Commercial Cabinet, 42.2"H x 24.2"W x 10"D, Light Gray, Pre-Configured.

K. Other-

- Panduit HLT21-XO Black Velcro 8" Tie Wrap, 10 pack.
- ERICO, Inc., CADDY CableCat Fasteners ("J" Hooks).
- Carlon CF4X1C-5200 corrugated FEP orange inner duct.

2.0 CABLE PLANT

2.1 EQUIPMENT AND TELECOMMUNICATIONS ROOM REQUIREMENTS

A.

Each BEF/IC/ER and HC/TR shall be a stand-alone wiring closet located centrally such that no single UTP horizontal cable run shall exceed 90 meters, when terminated at each end, nor shall horizontal cable runs span floors. There shall be a minimum of one (1) ER/TR per floor in a multi level building. BEF/IC/ER and HC/TR shall not be co-located in custodial, mechanical or other shared space where damage to critical electronics may occur. Each room shall be sized according to use, and meet the below listed criteria. Coordinate with a representative of ISU NeTel prior to installation of backboard, grounding and bonding system, and electrical service.

Floor Size: BEF/IC/ER 10' x 12' Minimum

Floor Size: HC/TR 8' x 10' Minimum

Floor Surface: Treated concrete or tile.

Floor loading: 50 lb/ft² minimum or as required by applicable codes.

Ceiling Height: 8.5 ft above finished floor

Door Size: 3' wide and 6.7' tall w/180° swing away from backboards and racks.

Wall Lining (backboard): AC-grade 3/4" x 4' x 8' sheets plywood, with no voids, covered on all sides with two coats flat black fire retardant paint.

Lighting: Minimum 500 lux measured at 3' above finished floor

Power: Provide (6) dedicated, isolated, non-switched, 4-way, 120Vac 20Amp circuits.

Grounding and Bonding: Install a contiguous Intra-building grounding and bonding system in compliance with NEC Article 250 and TIA/EIA-607 using a minimum conductor size of 6 AWG to be located on each plywood backboard with Ground Bus Bar as directed.

Security: Unique telecom key separate from building master, custodial, or mechanical.

Location: Room shall be located such that no single horizontal workstation cable shall exceed 90 meters from TO to TR/ER termination.

HVAC: Maintain constant temperature of 64° - 75° F with minimum of one air change per hour. Networking/Telecommunications equipment heat disipation is estimated at 3000 Watts per hour. $3.7 \times 3000 = 11,100$ BTU per hour.

Fire Protection: As required by applicable codes.

Equipment Rack: 7' x 19" equipment rack with wire management (as specified in materials list) and ladder rack shall be provided and installed as directed.

B.

No Intra or Inter-building telecommunications cable shall be run adjacent and parallel to power cabling. A minimum of 5" distance is required from any fluorescent lighting fixture or power line up to 2kVA and 24" from any power line over 5kVA. Similarly, cable should be routed and terminated as far as possible from sources of EMF, such as ballasts, generators, fans, motor control units, motors, etc.

C.

The BEF/IC/ER and HC/TR structured cable system shall be constructed using materials as specified in the materials list. Horizontal station cable, riser cables, and fiber optics shall be terminated in the appropriate location on the racking system. Voice cables shall be terminated on the appropriate 110 system. Data cables shall be terminated in the appropriate patch panels. Fiber optics shall be terminated in the appropriate fiber optic termination assembly. Cable termination, order of termination, color-coding, grouping, numbering plan, and labeling shall be performed in accordance with BICSI TDM Chapter 14 Telecommunications Administration and ISU NeTel conventions. Entrance facilities shall be terminated on the backboard with appropriate building entrance protection as specified by ISU NeTel. Riser shall be extended from the backboard building entrance protection panel to the 110 system on the rack. Coordinate with a representative of ISU NeTel prior to installation of BEF/IC/ER and HC/TR distribution and termination hardware.

2.2 ENTRANCE FACILITIES

A.

1. Outside cable plant facility requirements shall be coordinated with ISU NeTel. A minimum of (2) 4" inside diameter schedule 40 PVC conduits shall be run from the BEF/IC/ER to the designated vault or tunnel system. One of the 4" conduits shall have installed (4) 1" corrugated orange inner-duct. Conduits shall be buried a minimum of 24" from the surface on a foundation of 10" wet sand fill. A metallic locator ribbon shall be installed 12" above and parallel to the conduit. There shall be a minimum horizontal separation of 24" from co-located buried electrical service.

2. Outside plant requirements are determined per project. At a minimum, contractor shall ensure entrance facilities will support a multi-exchange carrier WAN environment with provisions for (1) DS3 circuit and (25) pair copper facilities with future expansion to OC48 and (100) pair copper facilities.

3. Grounding and Bonding shall conform to NEC Article 250 and TIA/EIA-607 using a minimum conductor size of 6 AWG.

2.3 HORIZONTAL WORKSTATION CABLE

- Each Workstation Telecommunications Outlet (TO) shall have (3) Category 5E cables. The gray cable and ivory jack shall be designated as analog voice and the blue and yellow cables and jacks shall be designated for data communications.
- Each Computer Lab TO shall have (2) Category 5E cables. The blue and yellow cables and jacks shall be designated for data communications.

A.

Each Telecommunications Outlet (TO) shall have (3) jacks in each outlet plate as follows: Install (1) Gray Category 5E (CAT 5E) 4-Pair UTP cable terminated at the TO in an Ivory RJ25C USOC jack and at the HC/TR in the rack mounted (or backboard mounted) 110 system as appropriate.

Install (1) Blue CAT 5E 4-Pair UTP cable terminated at the TO in a Blue RJ45 CAT 5E jack and at the HC/TR in the rack mounted patch panel system.

Install (1) Yellow CAT 5E 4-Pair UTP cable terminated at the TO in a Yellow RJ45 CAT 5E jack and at the HC/TR in the rack mounted patch panel system.

Cables shall be distributed in a horizontal star topology from each TO to the HC/TR. Total terminated length of cable from TO to HC/TR shall not exceed 90 meters total length. Each horizontal cable shall be installed in a "home-run" configuration. No "daisy chained" conduit or cables shall be allowed. No horizontal cable run shall span between floors. A minimum 12" service loop shall be provided at each TO and 24" at each HC/TR.

B.

All cables shall be installed using conduit, cable tray, or "J" hooks. Where cables are not installed in conduit or cable tray, the cable shall not be pulled or installed directly across suspended ceiling tiles or fluorescent lights without proper suspension and consideration of possible electrical interference. If "J" hooks are used, avoid placing any pressure or creating stress points on the cable. Maximum spacing between "J" hooks shall not exceed five feet. Suspended ceiling support wires shall not be used to support cables or cable support system(s).

C.

At no time shall pulling tension exceed 25 lbs. on horizontal cables. Exceeding the maximum recommended pulling tension during installation of cables will compromise wire integrity. If wire integrity is compromised, the wire may not pass testing and certification standards required for a 1000BaseTX infrastructure. The installing contractor will be responsible for replacement of any cable system that does not pass required certification standards. A representative from ISU NeTel may randomly test cable installations during weekly coordination meetings.

D.

Traditional nylon synch style Tie Wraps shall not be used to bundle cables. Only Velcro Tie Wraps are acceptable to bundle cables. Cables shall be dressed in loose, neat bundles.

E.

No Intra-building telecommunications cable shall be run adjacent and parallel to power cabling. A minimum of 5" distance is required from any fluorescent lighting fixture or power line up to 2kVA and 24" from any power line over 5kVA. Similarly, cable should be routed and terminated as far as possible from sources of EMF, such as ballasts, generators, fans, motor control units, motors, etc.

F.

Horizontal UTP station cable shall be terminated at the HC/TR in a manner such that each workstation location will be numbered and terminated in sequential order. Voice (Gray) cable shall be terminated at the 19" x 7' stand alone rack in rack mounted (or backboard mounted) 110 blocks as specified in materials list. Each 100 pair 110 block will support (24) 4-pair cables. Designator strips shall be blue in color. Data (Blue & Yellow) cables shall be terminated in Ortronics High Density T568A/B wired Patch Panels as specified in materials list and shall be located in 19" x 7' stand alone rack as specified in materials list. Horizontal and vertical fiber optic cable shall be terminated at BEF/IC/ER and HC/TR in Corning fiber optic distribution centers as specified in materials list. Coordinate with a representative of ISU NeTel prior to installation of BEF/IC/ER and HC/TR distribution and termination hardware.

G.

Each TO location shall use Ortronics TracJack hardware as specified in materials list. The gray CAT 5E cable shall be terminated USOC in an Ivory RJ25C jack. The Blue and Yellow CAT 5E cable(s) shall be terminated TIA/EIA T568A in (1) Blue and (1) Yellow CAT 5E RJ45 jacks. Striping of cable jacket, untwisting of conductor pairs and termination shall be done using TIA/EIA conventions. 12" of excess, jacketed, cable shall be coiled in the outlet box to accommodate future re-termination. Maintain UTP cable pair twists up to the point of termination (maximum of up to 1/4" jacket removal allowed) at both the station/outlet end as

well as patch panel/ block end for each horizontal cable. Take caution as to refrain from physically changing or damaging the shape or geometry of the cable during installation, i.e., do not cinch cable ties too tightly; avoid kinks and sharp bends in cable. Do not place bundles in such a way that the weight of large bundles is damaging the cables on the bottom of the bundle. Each TO wall plate shall be numbered sequentially, consistent with the HC/TR number layout using an acceptable labeling system. Coordinate with a representative of ISU NeTel prior to installation of TO termination hardware.

H.

Successful bidder shall test and certify, in writing, building wiring meets or exceeds all applicable TIA/EIA 568, 569, 606, 607, etc. conventions and standards. Successful bidder shall test and certify, in writing, building wiring shall support 1000Base TX/FX (gigabit) Ethernet technologies. Bidder shall warrant Telecommunications wiring for a period of not less than 25 years, (Ortronics/Berk-Tek NetClear Warranty) upon acceptance.

2.4 VERTICAL RISER CABLE

A.

Install a minimum of (2) 4" conduit paths between the BEF/IC/ER and each HC/TR.

B.

For each (12) telephone workstation locations there shall be a (25) pair copper riser from the HC/TR to the BEF/IC/ER. Copper riser cable shall be of a 25 Pair Category 5E FEP rated construction as specified in materials list. All riser cable shall be terminated using 110 wiring distribution systems as specified in materials list. Riser cable shall be terminated on a separate 100 pair block from horizontal station cable. Designator strips shall be gray in color. Coordinate with a representative of ISU NeTel prior to installation and termination of riser cable and termination hardware.

C.

Each HC/TR shall have a (6) stand multi-mode fiber optic cable run back to the BEF/IC/ER. Fiber Optic riser cable shall be Corning , (6) stand, multi-mode, FDDI performance, 62.5/125um, 3.5/1.0 dB, MIC, TBII tight buffer tube construction. Fiber optic cable shall be terminated in a Corning FDC cabinet at the BEF/IC/ER and each HC/TR. See materials list. Coordinate with a representative of ISU NeTel prior to installation of fiber optic riser cable.

2.5 PATHWAY SUPPORT SYSTEM

A.

All horizontal cable shall be installed using a home-run configuration. Conduit, cable tray or "J" hooks are acceptable in any combination to support the cable system.

B.

Conduits shall be dedicated, using no smaller than a 3/4" inside diameter per workstation outlet. There shall be no daisy-chain conduit runs. Each workstation location shall require one 3/4" conduit, which is a home run back to the appropriate HC/TR. Provide pull boxes in telecommunications conduit runs spaced not greater than 100 feet apart with no more than two right angle bends. If more than two bends are in any 100 foot section, increase the conduit by one trade size. See TIA/EIA-569-A Section 4.4. Place a "TELECOMMUNICATIONS" label on all pull and junction boxes. If a cable tray system is installed, the conduit shall be a home run from the workstation outlet jack to the tray. Conduit runs shall comply with cable fill capacity and bend design as specified in TIA/EIA-569-A documents.

C.

Traditional nylon synch style Tie Wraps shall not be used to bundle cables. Velcro style Tie Wraps are the only acceptable method to secure cable bundles. See materials list. At no time shall pulling tension exceed 25 lbs on horizontal cables. Exceeding the maximum recommended pulling tension on Category 5E cables will compromise cable integrity. If wire integrity is compromised, the wire may not pass testing and certification standards required for a 1000BaseTX infrastructure. The installing contractor will be responsible for replacement of any cable system that does not meet required standards.


D.

No intra/inter-building telecommunications cable shall be run adjacent and parallel to power cabling. A minimum of 5" distance is required from any fluorescent lighting fixture or power line up to 2kVA and 24" from any power line over 5kVA. Similarly, cable should be routed and terminated as far as possible from sources of EMF, such as generators, motors etc.


Glossary:



| | |
|-------|--|
| BDF | Building Distribution Frame |
| BEF | Building Entrance Frame |
| BET | Building Entrance Termination |
| BICSI | Building Industry Consulting Service International |
| ER | Equipment Room |
| HC | Horizontal Cross Connect |
| IC | Intermediate Cross Connect |
| IDF | Intermediate Distribution Frame |
| MC | Main Cross Connect |
| MDF | Main Distribution Frame |
| RCDD | Registered Communications Distribution Designer |
| TO | Telecommunications Outlet |
| TR | Telecommunications Room |
| UTP | Unshielded Twisted Pair |
| FO | Fiber Optics |

Building Entrance Facility BEF/IC/ER Conceptual Backboard

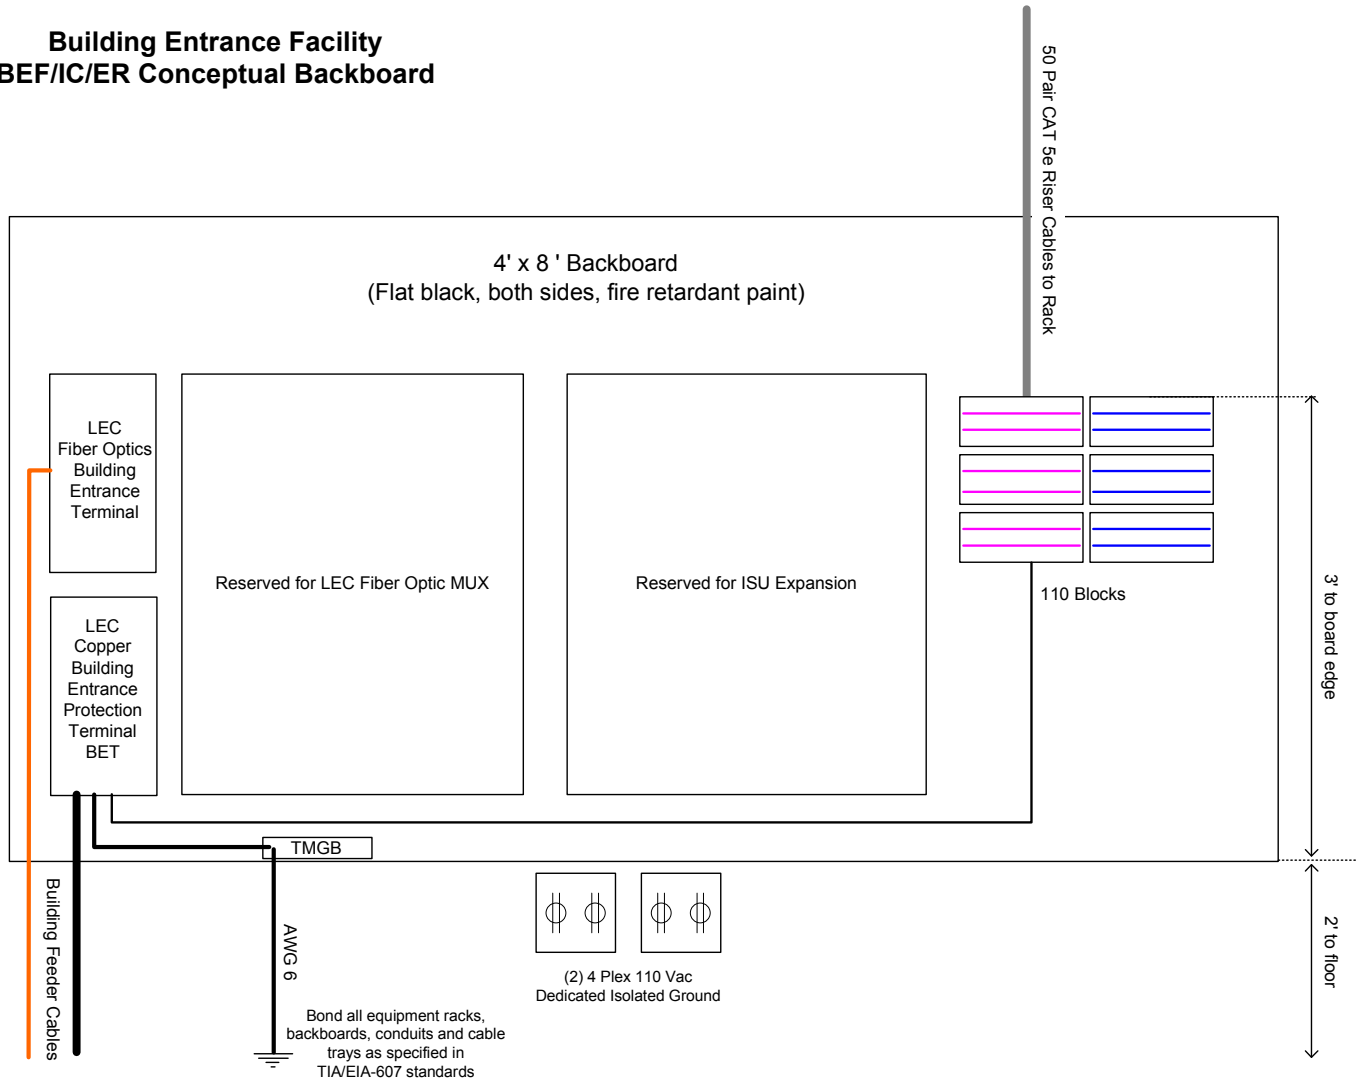


Conceptual Conduit & Riser Diagram

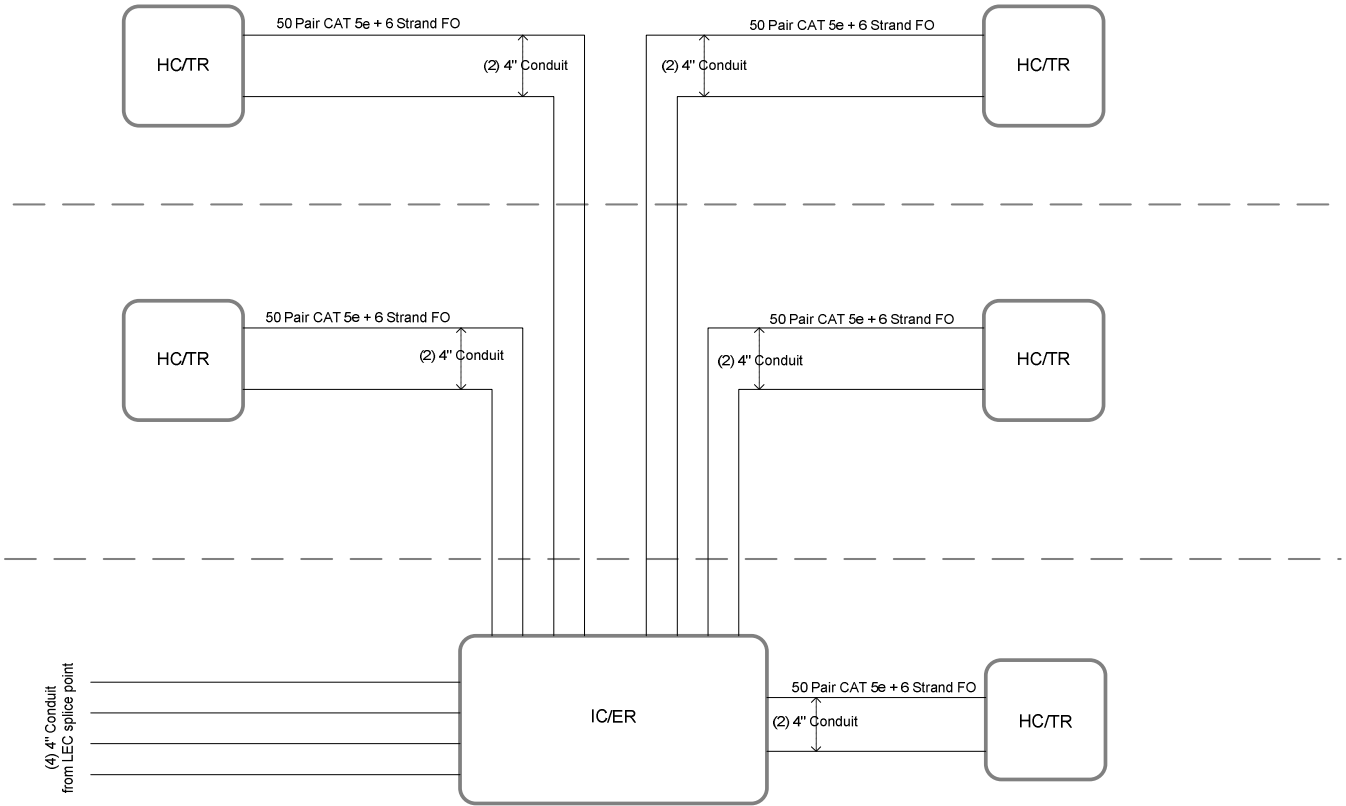

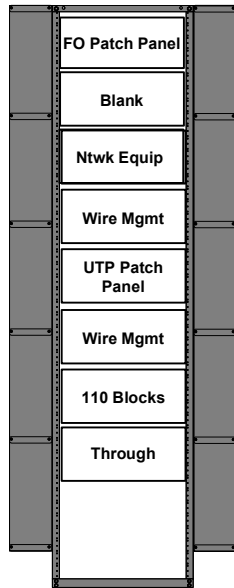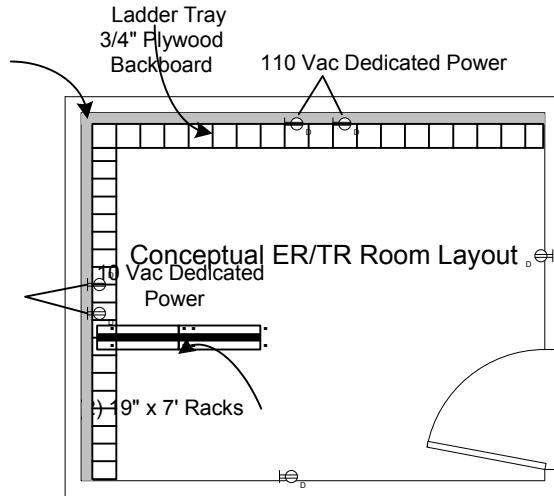

Conceptual (1) Rack Layout

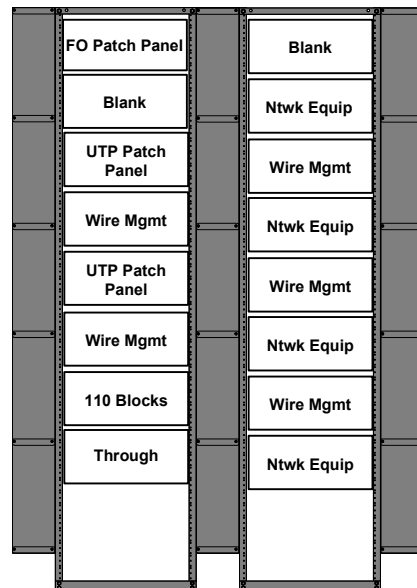

Conceptual (2) Rack Layout

Submission by:
 Mark S Norviel, RCDD/NTS
 Registration No. 09450 & 03711
 Expires 12/31/09 & 12/31/11